



WEIGHT OF CONCRETE TO RESIST
100% OF TOTAL THRUST

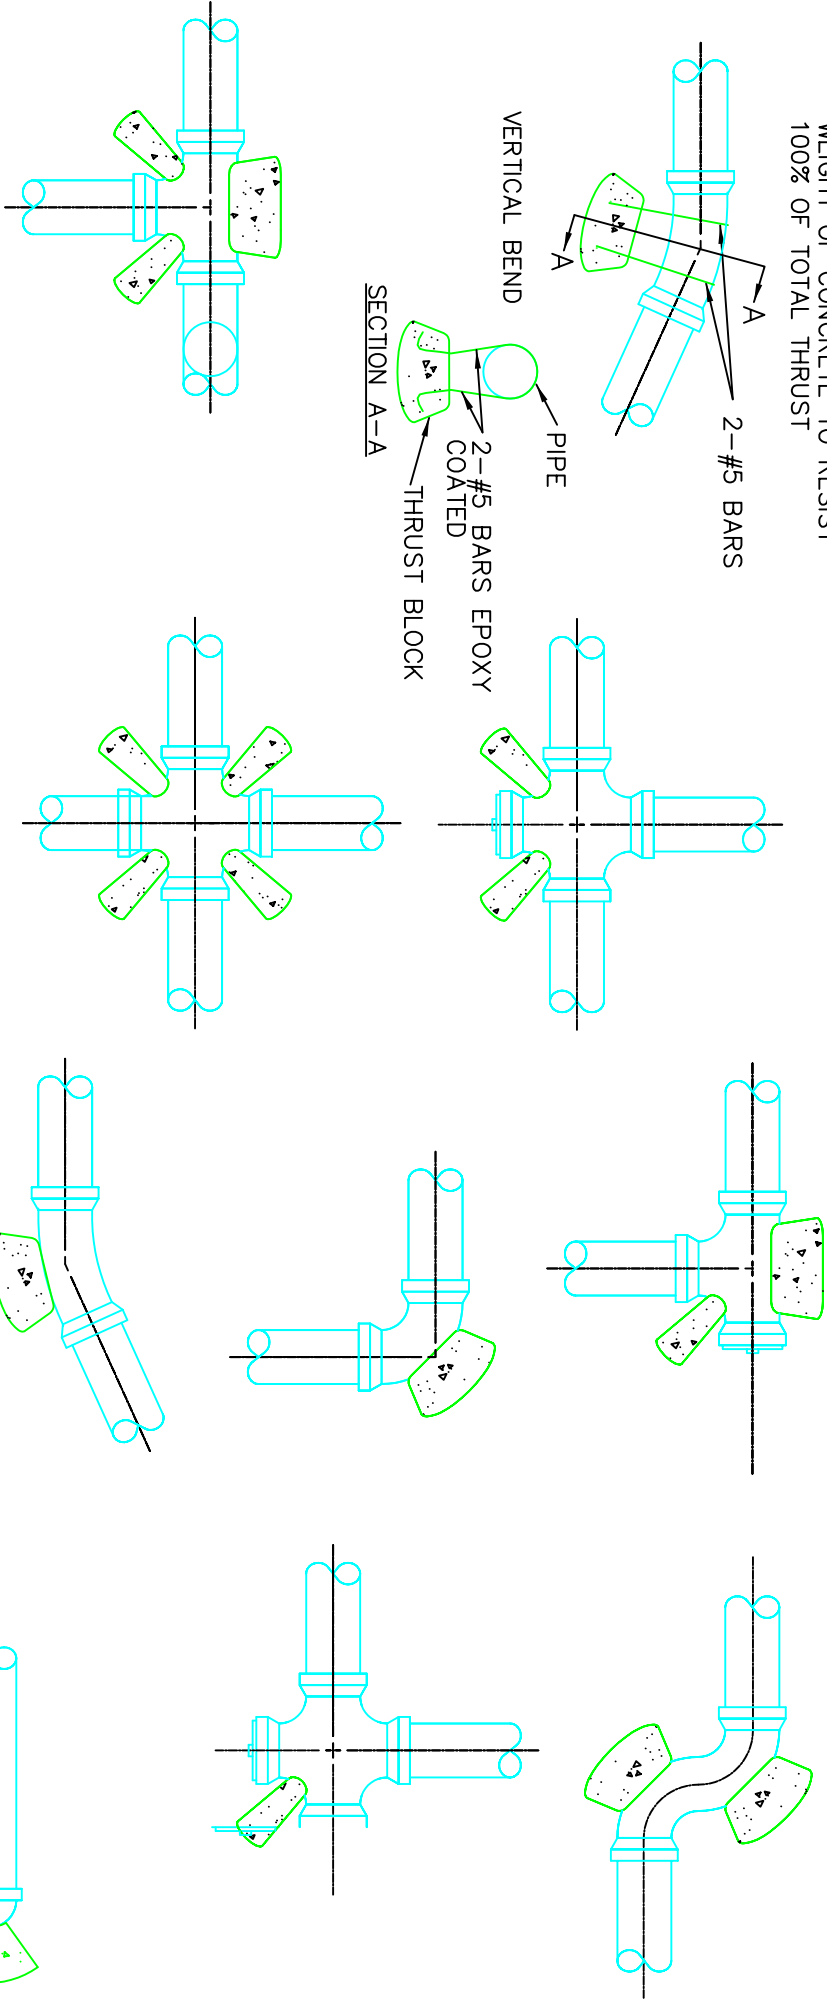

HORIZONTAL BEND



HORIZONTAL BEND

- NOTES:
1. THRUST BLOCK TO BE SIZED USING 200 PSI AND SOIL BEARING PRESSURE AS DETERMINED FROM A SITE SPECIFIC SOILS REPORT.

2. REFER TO THRUST BLOCK TABLE IN THE PROJECT PLANS FOR MINIMUM CONCRETE BEARING AREAS AND DIMENSIONS

SCALE: NONE

1	RSS	UPDATE REVIEWED	12/21/99 2004	 SANDY CITY 1893 STATE OF UTAH	STANDARD DETAIL FIGURE_7 THRUST BLOCK INSTALLATIONS
1					
NO.	AUTHORIZED BY	REVISIONS	DATE		